
RFP ADDENDUM

RFP Title: DEPLOYMENT OF PUBLIC ELECTRIC VEHICLE CHARGING STATIONS IN MORDEN, MANITOBA

RFP#: COM-PE-03-2025

Addendum #: 04

Issue Date of this Addendum: June 27, 2025

Addendum:**1. RFP Amendments:**

Item/clause/section	Item Description	Description of change
Addendum #02	Layout Drawing	a) Replace the layout Drawing included in the Addendum#2 with the Drawing included in this Addendum #4.

2. Questions and Answers:

Q1: Is one pedestal with two units, acceptable?

Ans: Yes

Q2: Is the post required to be non-combustible?

Ans: Yes

Q3: Are there specifications for the installation of the base of said posts?

Ans: No. Vendor to propose.

Q4: For the bollards, does the City have specifications?


Ans: No. Vendor to propose.

Q5: Is the City looking for cable management for the 19.2kW EVSE units at both locations?

Ans: Yes

Q6: Does the City have specific requirements where the panel feeding the units is to be located? Inside or outside of the building at either location?

Ans: No specific requirements.

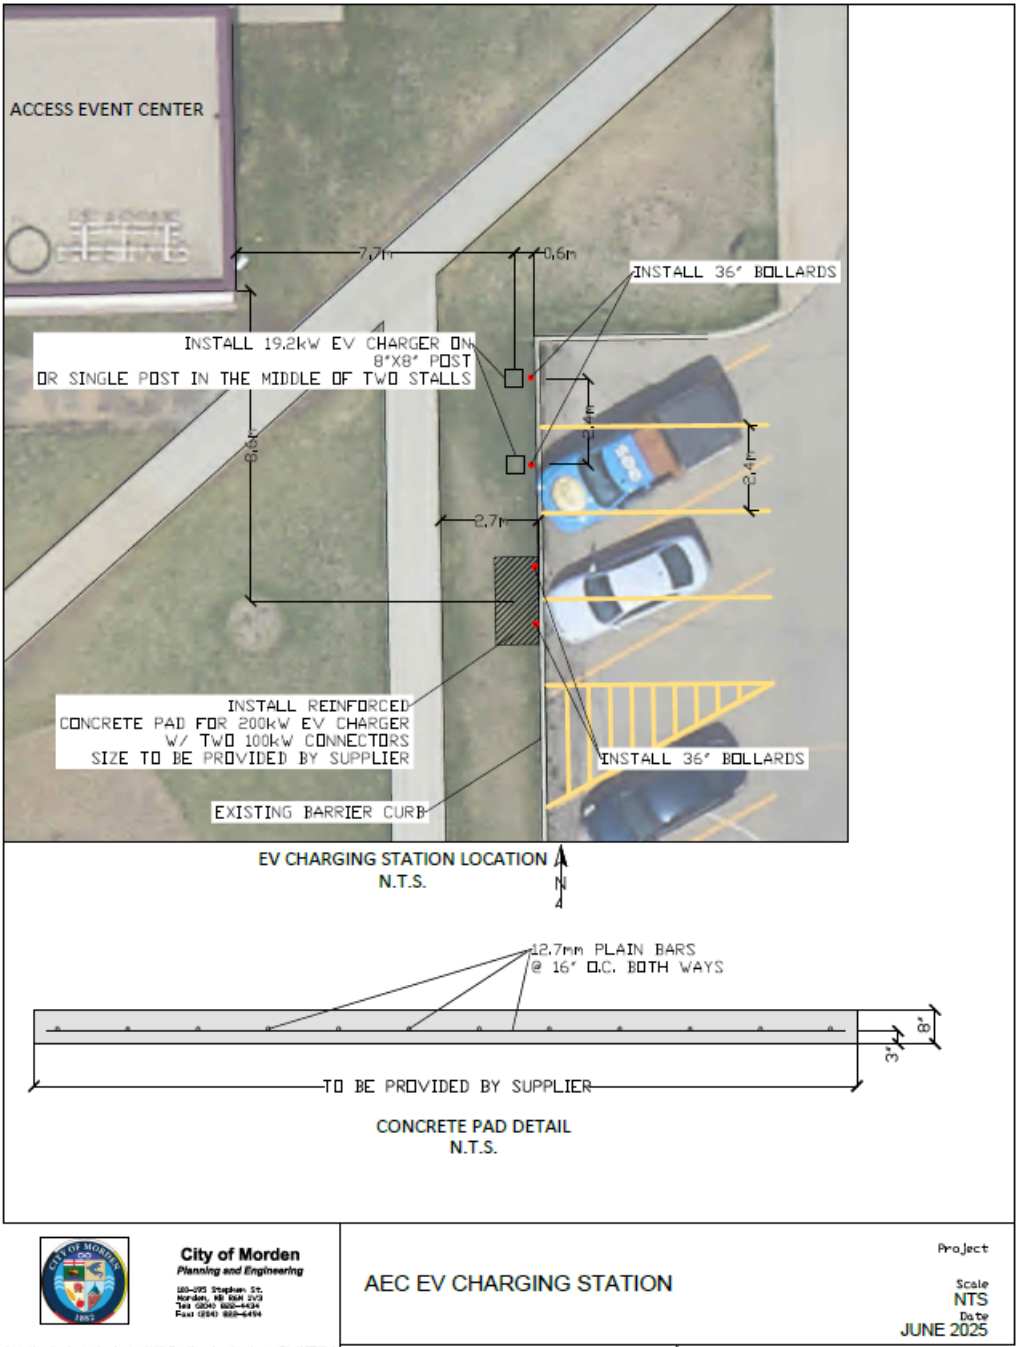

END OF ADDENDUM # 04